Application

4 door classroom lockdown

Operation


All doors are normally energized and the electric strikes are unlocked. The SLP-1M buttons are illuminated green. Pressing any of the SLP-1M buttons will toggle the TM-2 to de-energize and lock all of the electric strikes and LED will turn RED. Pressing any of the SLP-1M buttons to toggle the TM-2 back and return the system to Normal Conditions.

System Components

Power Supply: BPS-24-2
Electric Strikes: Adams Rite 7400*
Push Buttons: Alarm Controls SLP-1M
Timer: TM-2


*Different fail-secure electric strikes may be required depending on locking hardware

Point to Point Wiring Diagram

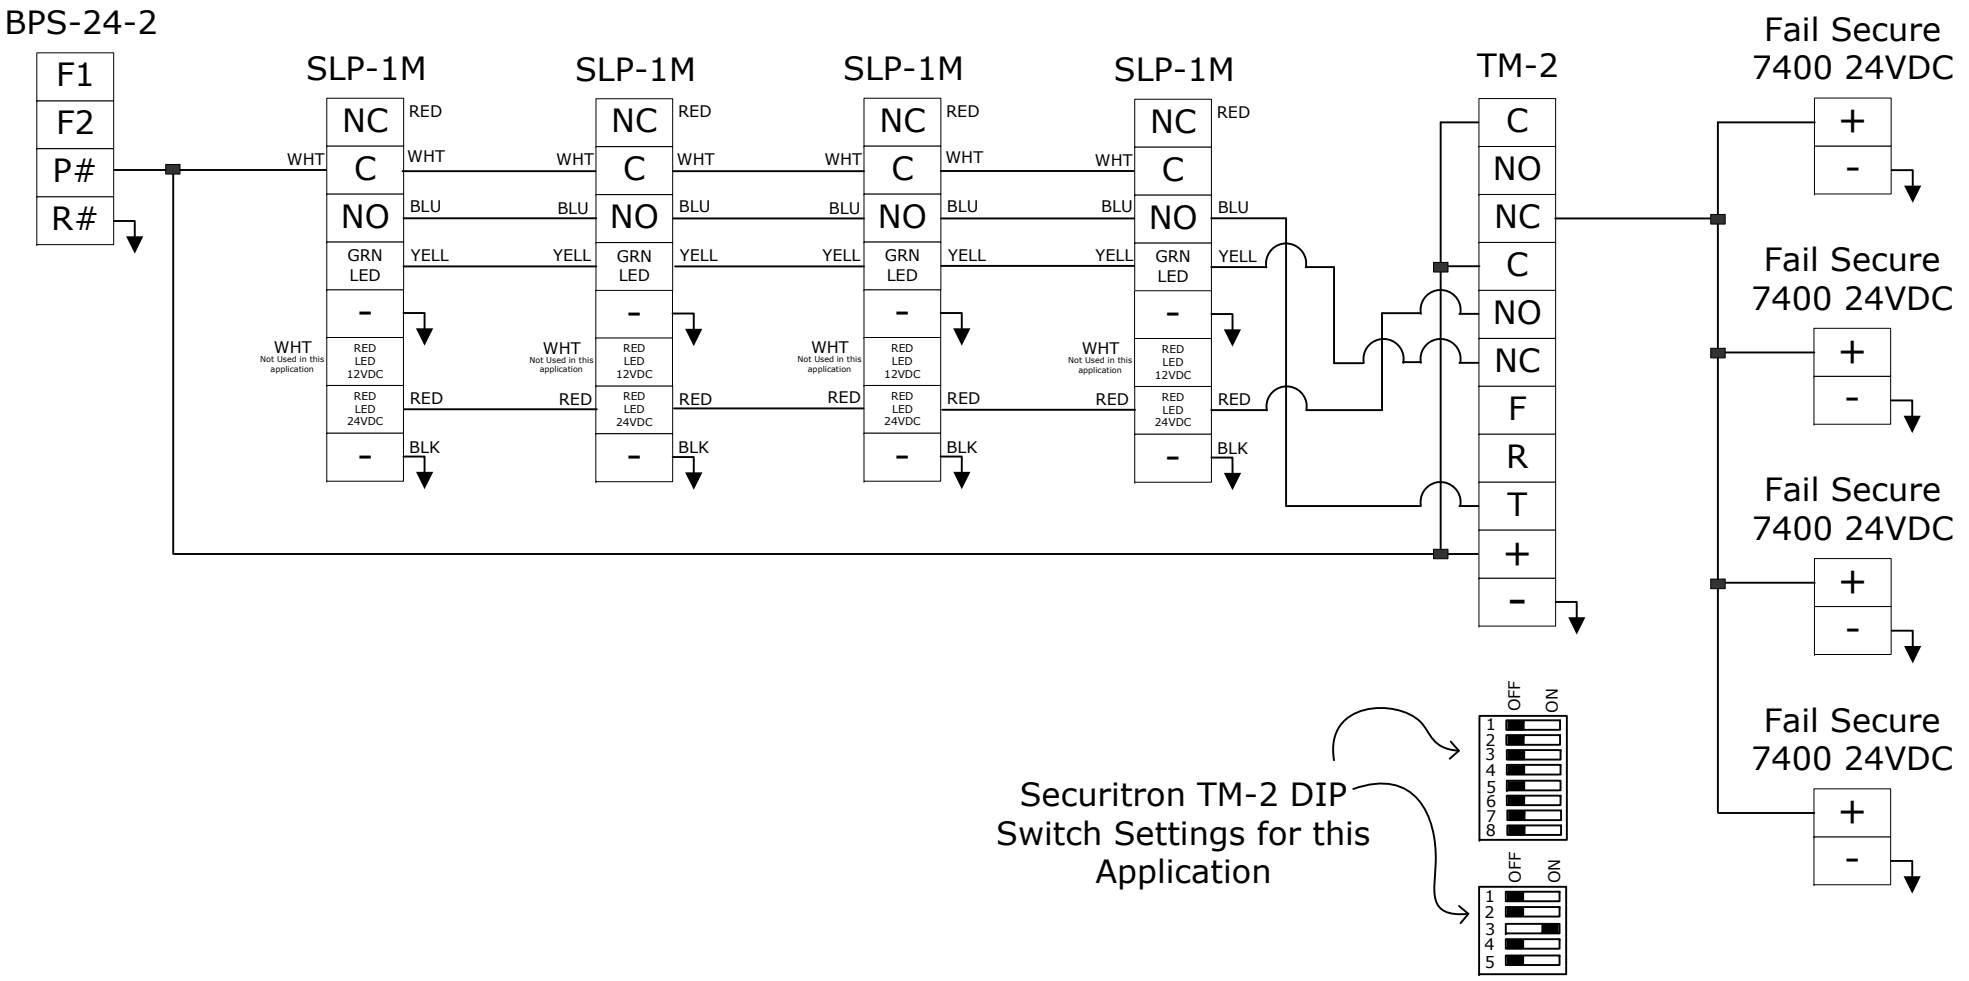

Comments:

ASSA ABLOY

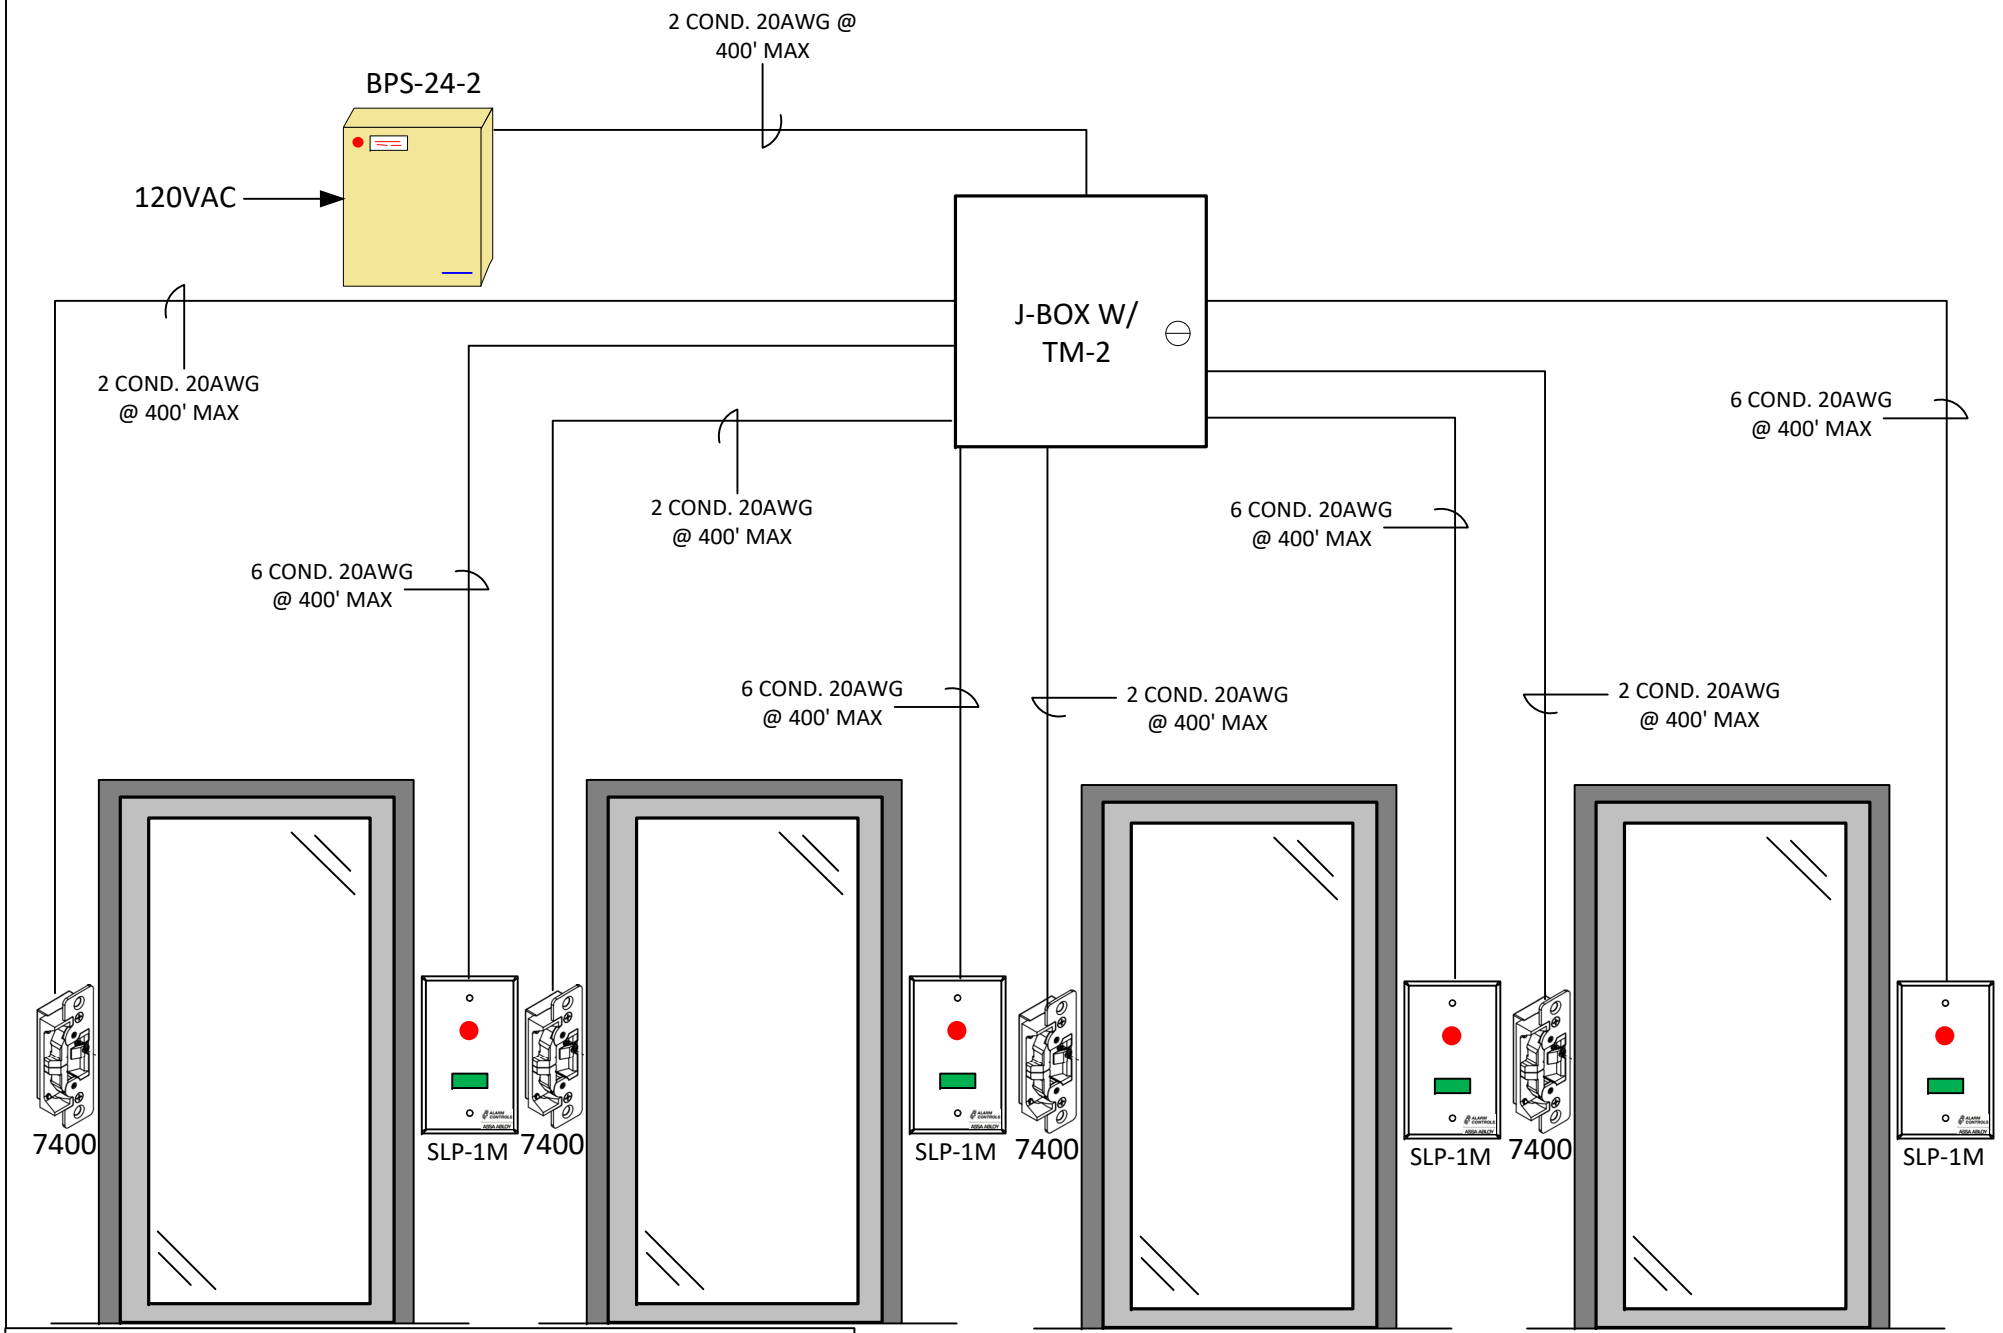

Comments:

ASSA ABLOY